
2018 Fish Passage Plan

Chapter 7 – Lower Monumental Dam

Table of Contents

1. FISH PASSAGE INFORMATION	4
1.1. Juvenile Fish Passage.	4
1.2. Adult Fish Passage.....	6
2. FISH FACILITIES OPERATIONS	8
2.1. General.....	8
2.2. Spill Management.	8
2.3. Operating Criteria – Juvenile Fish Facilities.	9
2.4. Operating Criteria - Adult Fish Facilities.	16
2.5. Fish Facility Monitoring and Reporting.....	19
3. FISH FACILITIES MAINTENANCE	19
3.1. Dewatering & Fish Handling.	19
3.2. Maintenance - Juvenile Fish Facilities.....	20
3.3. Maintenance - Adult Fish Facilities.	21
4. TURBINE UNIT OPERATION & MAINTENANCE.....	23
4.1. Turbine Unit Priority Order.	23
4.2. Turbine Unit Operating Range.....	24
4.3. Turbine Unit Maintenance.....	26
5. FOREBAY DEBRIS REMOVAL	28

Chapter 7 - Lower Monumental Dam

Project Acronym*	LMN
River Mile (RM)	Snake River RM 41.6
Reservoir	Lake Herbert G. West
Minimum Instantaneous Flow (kcfs)	Dec–Feb: 0 kcfs \ Mar–Nov: 11.5 kcfs
Forebay Normal Operating Range (ft)	537' – 540'
Tailrace Rate of Change Limit (ft/hr)	1.5'/hr
Powerhouse Length (ft)	656'
Powerhouse Hydraulic Capacity (kcfs)	130 kcfs
Turbine Units (#)	6 (Units 1-3 BLH Kaplan; Units 4-6 Allis Chalmers Kaplan)
Turbine Unit Generating Capacity (MW)	Rated: 810 MW (Units 1-6 @135 MW). Maximum: 930 MW (Units 1-6 @155 MW)
Gatewell Orifice Diameter	12"
Spillway Length (ft)	498'
Spillway Hydraulic Capacity (kcfs)	850 kcfs
Spillbays (#)	8
Spillway Weirs (#)	1 Removable Spillway Weir (RSW) in Bay 8
Navigation Lock Length x Width (ft)	650' x 84' (Usable Space)
Navigation Lock Max. Lift (ft)	100'
FISH STRUCTURE/OPERATION START DATE	
Juvenile Bypass System (JBS)	1969 (1 st Generation) / 1991 (current)
Submersible Traveling Screens (STS)	1992
Juvenile Fish Transportation Program - Corps	1993
Removable Spillway Weir (RSW)	2008
Bypass Outfall Flume Relocation	2012
Adult Fish Counts	1969 (South Shore & North Shore)

*Project acronym designated by US Army Corps of Engineers, Northwestern Division, Columbia Basin Water Management Division. Due to the large number of projects managed by NWD, this acronym may differ from other acronyms used in the region. For example, a common acronym for Lower Monumental is **LMO**. However, that acronym is assigned to another NWD project, so the official Corps NWD acronym is **LMN**.

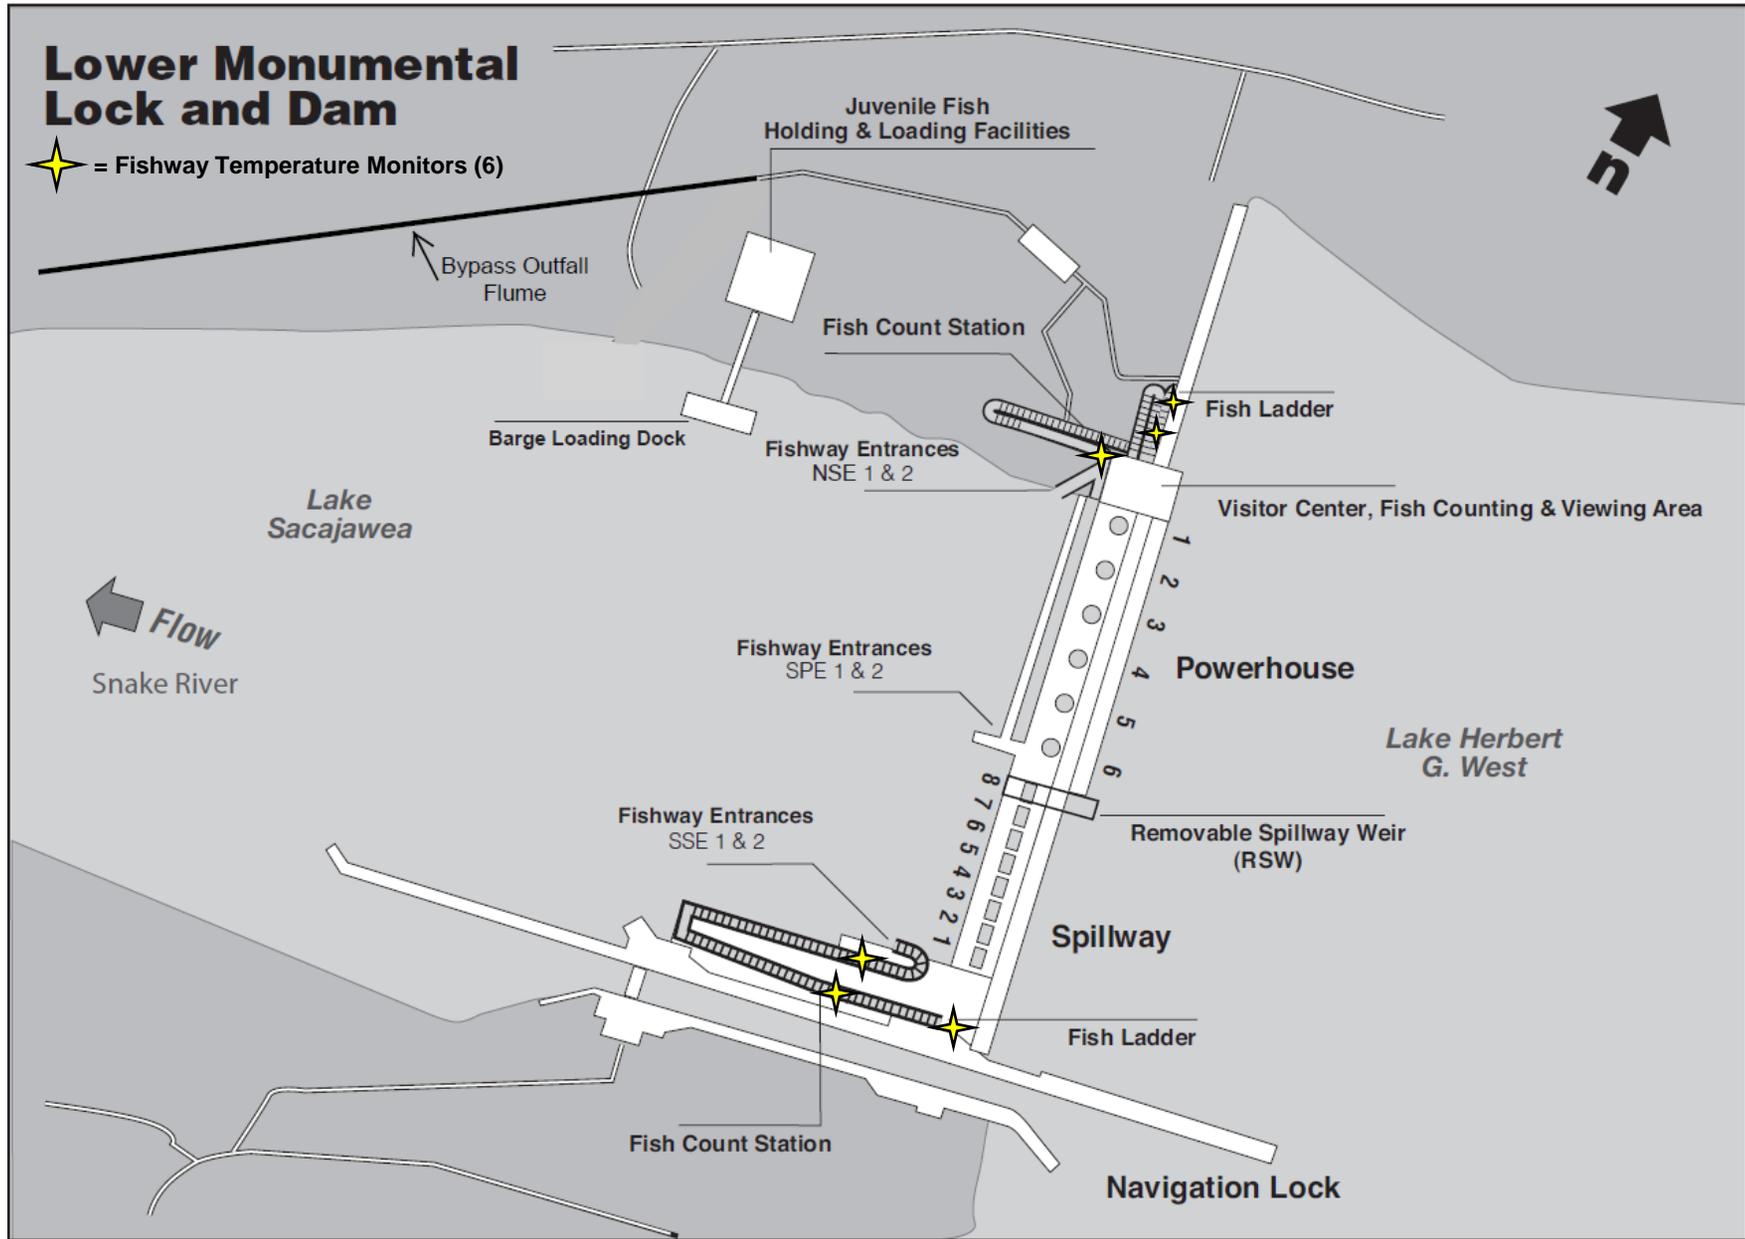


Figure LMN-1. Lower Monumental Lock & Dam General Site Plan.

Table LMN-1. Lower Monumental Dam Schedule of Operations and Actions Defined in the 2018 Fish Passage Plan.

Task Name	Start	End	FPP Section	2018											
				Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Jan
FISH PASSAGE FACILITIES	3/1/18	3/31/19													
Adult Facilities - Fish Passage Season	3/1/18	12/31/18	2.4.2												
Adult Facilities - Winter Maintenance	1/1/19	2/28/19	2.4.1												
Juvenile Facilities - Fish Passage Season	4/1/18	12/15/18	2.3.2												
Juvenile Facilities - Winter Maintenance	3/1/18	3/31/18	2.3.1												
	12/16/18	3/31/19													
PROJECT OPERATIONS FOR FISH PASSAGE	3/1/18	12/15/18													
Turbine unit priority order	3/1/18	11/30/18	Table LMN-5												
Turbine unit 1% operating range	4/1/18	10/31/18	4.2												
Backflush orifices ≥ once per 8 hrs	4/1/18	7/31/18	2.3.2.3.vi												
Avian hazing	4/2/18	6/2/18	App L 7.2												
Avian Wires installed NLT April 3	4/3/18	4/3/18	App L 1.4												
Spillway weir in service (end date approx)	4/3/18	8/31/18	2.3.2.7												
Spring Spill	4/3/18	6/20/18	App E (FOP)												
Summer Spill	6/21/18	8/31/18	App E (FOP)												
STS removal during cold weather	11/22/18	12/15/18	2.3.2.2												
SPECIAL OPS & STUDIES (Appendix A)	3/1/18	2/28/19													
Unit 1 Rehab (started Jan 2016)	3/1/18	5/31/18	App A 7.1												
Navigation Lock annual outage	3/3/18	3/18/18	App A 1.4												
Doble testing	7/27/18	8/2/18	App A 1.5												
Model Validation Testing	9/1/18	2/28/19	App A 7.1												
Stilling Basin Surveys (all Snake R. projects)	9/15/18	10/31/18	App A 7.2												
TDG MONITORING	3/1/18	2/28/19													
TDG Monitoring - Tailrace (year-round)	3/1/18	2/28/19	2.2												
TDG Monitoring - Forebay	4/1/18	8/31/18	2.2												
ADULT FISH COUNTING	4/1/18	10/31/18													
Day Visual 0500-2100 PDT	4/1/18	10/31/18	Table LMN-3												
REPORTS	3/1/18	3/15/19													
Weekly Reports	3/1/18	12/31/18	2.5.2												
Annual Report due	3/15/19	3/15/19	2.5.3												

1. FISH PASSAGE INFORMATION

Lower Monumental Lock & Dam fish passage facilities and other structures are shown in **Figure LMN-1**. The schedule of Lower Monumental operations that are described in the Fish Passage Plan (FPP) and Appendices is in **Table LMN-1**.

1.1. Juvenile Fish Passage.

1.1.1. Juvenile Fish Facilities. The Lower Monumental juvenile fish facilities consist of standard-length submersible traveling screens (STS), vertical barrier screens (VBS), 12" orifices, collection gallery, dewatering structure, and a bypass flume to the tailrace. Transportation facilities consist of a separator to sort by size and separate from adult fish, sampling facilities, raceways, office and sampling building, truck and barge loading facilities, and PIT-tag detection and deflector systems. Maintenance of juvenile fish facilities that may impact fish or facility operations should be conducted during the winter maintenance period.

1.1.2. Juvenile Fish Migration Timing. Juvenile fish passage timing at Lower Monumental Dam is shown in **Table LMN-2**, based on collection data from the most recent 10-year period (does not reflect fish guidance efficiency or passage via the RSW or spillway). Salmon, steelhead, bull trout, lamprey, and other species are routinely counted.

Table LMN-2. Juvenile Salmonid Passage Timing at Lower Monumental Dam for Most Recent 10 Years Based on Daily & Yearly Collection Data.

Year	10%	50%	90%	# Days	10%	50%	90%	# Days
	Yearling Chinook				Subyearling Chinook			
2008	18-May	21-May	28-May	10	5-Jun	14-Jun	5-Jul	30
2009	10-May	20-May	27-May	17	2-Jun	9-Jun	3-Jul	31
2010	18-May	21-May	8-Jun	21	8-Jun	12-Jun	7-Jul	29
2011	10-May	15-May	21-May	11	31-May	23-Jun	24-Jul	54
2012	6-May	12-May	24-May	18	6-Jun	19-Jun	6-Jul	30
2013	9-May	13-May	16-May	7	5-Jun	12-Jun	13-Jul	38
2014	3-May	8-May	21-May	18	3-Jun	11-Jun	11-Jul	38
2015	2-May	8-May	14-May	12	30-May	8-Jun	30-Jun	31
2016	22-Apr	5-May	11-May	19	5-Jun	11-Jun	5-Jul	30
2017	18-Apr	6-May	14-May	26	18-Apr	6-May	17-Jun	60
10-Yr MEDIAN	7-May	12-May	21-May	18	4-Jun	11-Jun	5-Jul	31
10-Yr MIN	18-Apr	5-May	11-May	7	18-Apr	6-May	17-Jun	29
10-Yr MAX	18-May	21-May	8-Jun	26	8-Jun	23-Jun	24-Jul	60
	Unclipped Steelhead				Clipped Steelhead			
2008	20-May	21-May	31-May	11	18-May	21-May	28-May	10
2009	10-May	22-May	6-Jun	27	10-May	20-May	1-Jun	22
2010	18-May	26-May	11-Jun	24	8-May	23-May	9-Jun	32
2011	14-May	20-May	1-Jun	18	11-May	16-May	29-May	18
2012	8-May	19-May	2-Jun	25	7-May	15-May	27-May	20
2013	9-May	14-May	21-May	12	8-May	14-May	19-May	11
2014	3-May	15-May	28-May	25	2-May	8-May	25-May	23
2015	3-May	12-May	22-May	19	1-May	8-May	20-May	19
2016	20-Apr	6-May	16-May	26	22-Apr	30-Apr	11-May	19
2017	22-Apr	9-May	23-May	31	20-Apr	2-May	13-May	23
10-Yr MEDIAN	8-May	17-May	29-May	25	7-May	14-May	26-May	20
10-Yr MIN	20-Apr	6-May	16-May	11	20-Apr	30-Apr	11-May	10
10-Yr MAX	20-May	26-May	11-Jun	31	18-May	23-May	9-Jun	32
	Coho				Sockeye (Wild & Hatchery)			
2008	20-May	20-May	24-May	4	21-May	22-May	3-Jun	13
2009	18-May	26-May	30-Jun	43	20-May	23-May	2-Jun	13
2010	19-May	5-Jun	14-Jun	26	23-May	3-Jun	16-Jun	24
2011	13-May	21-May	3-Jun	21	13-May	30-May	12-Jun	30
2012	9-May	22-May	5-Jun	27	9-May	22-May	3-Jun	25
2013	10-May	14-May	22-May	12	18-May	20-May	23-May	5
2014	7-May	21-May	29-May	22	3-May	14-May	25-May	22
2015	10-May	18-May	29-May	19	16-May	19-May	21-May	5
2016	2-May	9-May	19-May	17	21-May	22-May	26-May	5
2017	9-May	15-May	29-May	20	20-Apr	14-May	26-May	36
10-Yr MEDIAN	10-May	20-May	29-May	21	17-May	22-May	29-May	18
10-Yr MIN	2-May	9-May	19-May	4	20-Apr	14-May	21-May	5
10-Yr MAX	20-May	5-Jun	30-Jun	43	23-May	3-Jun	16-Jun	36

1.2. Adult Fish Passage.

1.2.1. Adult Fish Facilities. Lower Monumental adult fish facilities are comprised of north and south shore ladders and collection systems with a common auxiliary water supply. Maintenance occurs in Jan–Feb, typically one shore at a time to minimize impacts on upstream migrants.

1.2.1.1. The north shore ladder connects to two north shore entrances and the powerhouse collection system. The powerhouse collection system has two entrances at the downstream south end of the powerhouse (a former side entrance is permanently closed) and a common transportation channel. Two north shore entrances, two downstream south powerhouse entrances, and none of the floating orifices will be used during fish passage season.

1.2.1.2. The south shore ladder has two downstream entrances (a former side entrance is permanently closed). Three turbine-driven pumps provide auxiliary water from the north side of the powerhouse to the powerhouse diffusers via a supply conduit under the powerhouse collection channel, and to the south shore collection system diffuser via a supply conduit under the spillway. Excess water from the juvenile bypass system (approximately 200-240 cfs) is added to the auxiliary water supply for the powerhouse collection system.

1.2.2. Adult Fish Migration Timing & Counting.

1.2.2.1. Upstream migrants are present throughout the year and adult facilities are operated year-round. Adult salmon, steelhead, shad, and lamprey are counted per the schedule in **Table LMN-3**, and data are posted daily at: www.fpc.org/adultsalmon_home.html. Sturgeon and bull trout are relatively infrequent and are reported in *Miscellaneous Fish Counts* and in the *Annual Fish Passage Report*. Relatively few fish pass through the south ladder so one person can count both ladders simultaneously from the north shore counting room by direct observation of the north viewing window and by video monitor connected to the south shore counting room.

1.2.2.2. Yearly counts through the most recent passage year are used to determine the earliest and latest dates of peak adult fish passage defined in **Table LMN-4**. Time-of-day (diel) distributions of adult salmonids at fishway entrances and exits are shown in **Figure LMN-2**.

Table LMN-3. Lower Monumental Dam Adult Fish Counting Schedule, 3/1/18-2/28/19.

Count Period	Counting Method and Hours *
April 1 – October 31	Visual 0500–2100 hours (PDT)

*PST=Pacific Standard Time. PDT=Pacific Daylight Time (in effect during Daylight Saving Time 3/11/18-11/4/18).

Table LMN-4. Lower Monumental Dam Adult Fish Count Period and Peak Passage Timing (based on yearly counts from 1969 through most recent count year).

Species	Count Period	Earliest Peak	Latest Peak
Spring Chinook	Apr 1 – Jun 13	Apr 20	May 28
Summer Chinook	Jun 14 – Aug 13	Jun 14	Jul 12
Fall Chinook	Aug 14 – Oct 31	Sep 4	Sep 30
Steelhead	Apr 1 – Oct 31	Sep 13	Oct 13
Sockeye	Apr 1 – Oct 31	Jun 24	Jul 25
Lamprey	Apr 1 – Oct 31	Jul 14	Aug 8

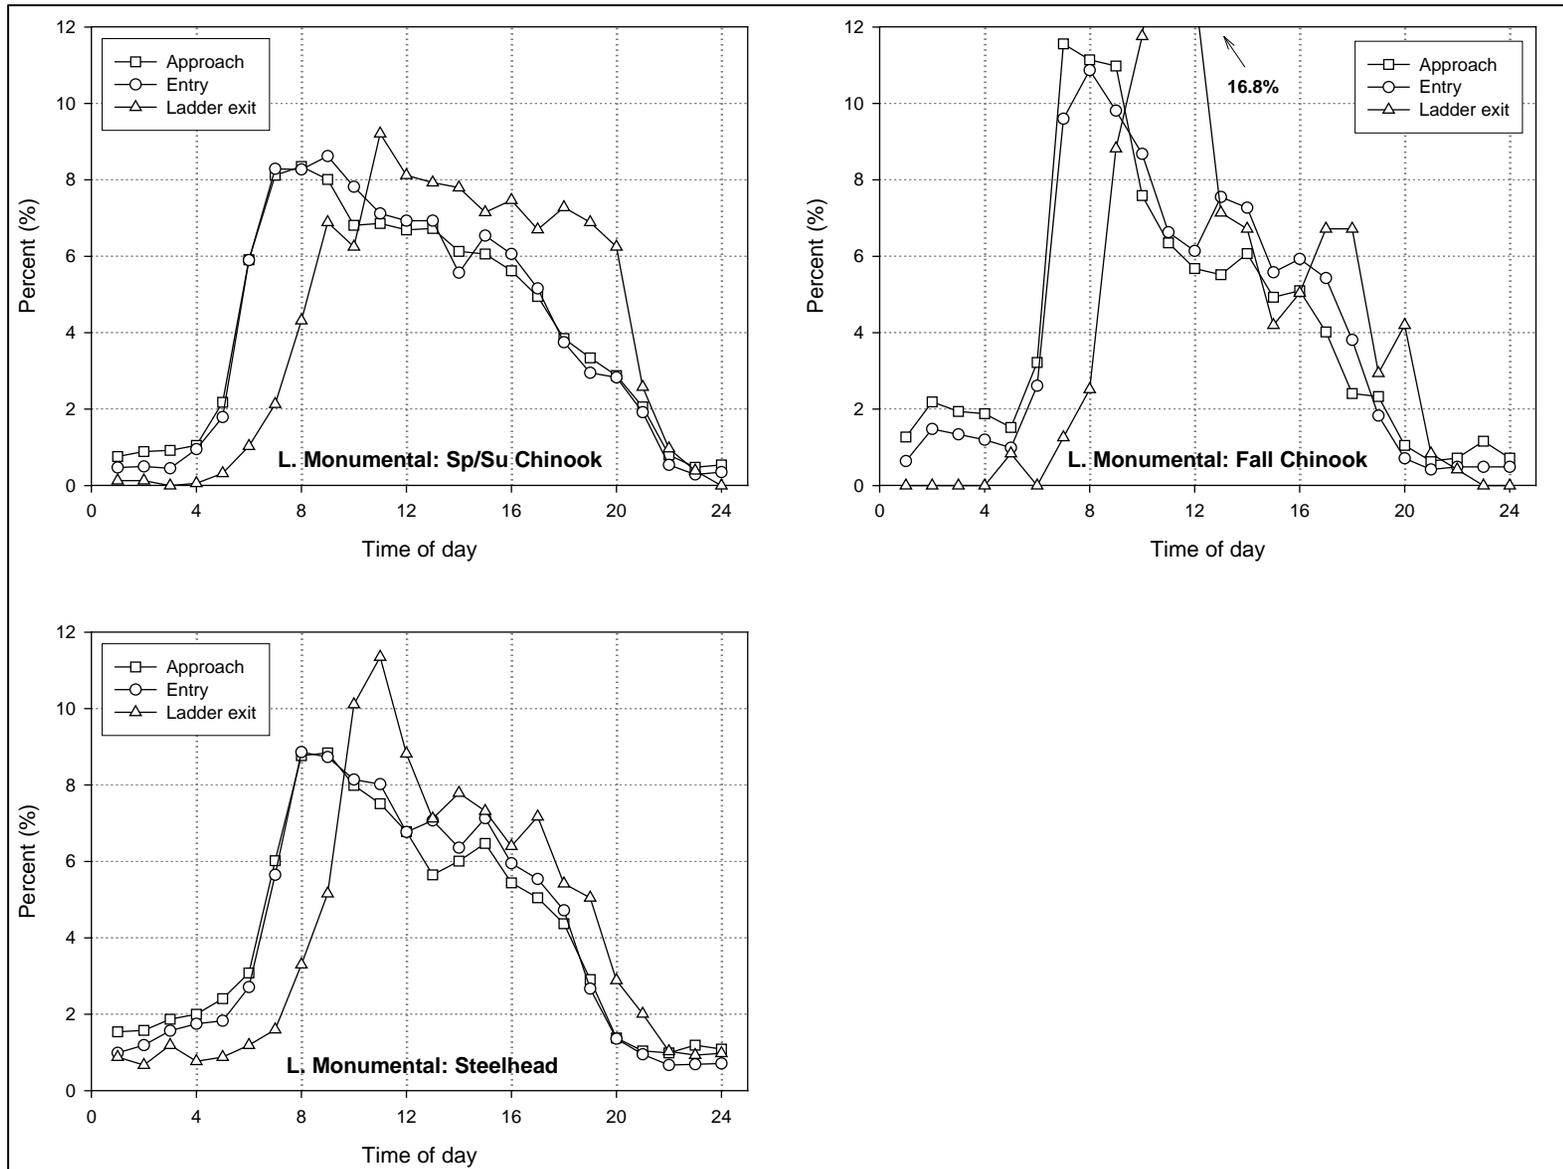


Figure LMN-2. Diel Distribution of Adult Salmonids at Lower Monumental Fishway Entrances and Exits (Keefer & Caudill 2008).

web.crohms.org/tmt/documents/FPOM/2010/2013_FPOM_MEET/2013_JUN/

2. FISH FACILITIES OPERATIONS

2.1. General.

2.1.1. Yearly special operations related to research are described as currently coordinated in **Appendix A - Special Project Operations & Studies.**

2.1.2. Research, non-routine maintenance activities, and construction will not be conducted within 100' of any fishway entrance or exit, within 50' of any other part of the adult fishway, or directly in, above, or adjacent to any fishway, unless coordinated with FPOM or FFDRWG by the Project, District Operations and/or Planning or Construction office. These distances are approximate and will be updated after data are collected and analyzed to determine the threshold for adverse impacts to adult fish behavior. Alternate actions will be considered by District and Project biologists in conjunction with the Regional fish agencies on a case-by-case basis.

2.1.3. Emergency situations should be dealt with immediately by the Project in coordination with the Project and/or District biologist. If unavailable, the biologists will be informed immediately following the incident of steps taken to correct the situation. On a monthly basis, as necessary, the project biologist will provide FPOM a summary of any emergency actions undertaken.

2.1.4. All activities within boat restricted zones (BRZ) will be coordinated with the Project at least two weeks in advance, unless it is deemed an emergency (see also **FPP Chapter 1 - Overview** for coordination guidance).

2.2. Spill Management.

2.2.1. Spring and summer spill operations for juvenile fish passage are defined in the *Fish Operations Plan* (FOP), included in the Fish Passage Plan as **Appendix E**. Spill at Lower Monumental will be distributed in patterns defined in **Table LMN-7 through LMN-9.**

2.2.2. Involuntary spill is the result of river flow above powerhouse capacity, insufficient load (lack of load), turbine unit outages (forced or scheduled), or failure of a key component of the juvenile fish passage facility which forces spill to provide juvenile fish passage.

2.2.3. Total dissolved gas (TDG) is monitored at Lower Monumental Dam during the periods defined in **Table LMN-1**, pursuant to the Corps' annual *TDG Monitoring Plan and Dissolved Gas Monitoring Plan of Action 2015-2018*.¹

2.2.4. To ensure navigation safety, short-term spill adjustments may be required, including spill reduction, spill pattern adjustments, and/or spill stoppages that result in forebay exceedances of the Minimum Operating Pool (MOP) range. The Corps will make short-term spill adjustments in real-time as appropriate to provide safe navigation conditions. Actual operations will vary depending on spill patterns, turbine operations, experience of boat captains, etc. See the FOP (**Appendix E**) for more information.

¹TDG Monitoring Plan (Appendix 4 of the WMP): pweb.crohms.org/tmt/documents/wmp/. TDG Monitoring Plan 2015-2018: pweb.crohms.org/tmt/wqnew/tdg_monitoring/2015-18.pdf

2.3. Operating Criteria – Juvenile Fish Facilities.

2.3.1. Juvenile Facilities - Winter Maintenance (December 16–March 31).

2.3.1.1. Forebay Area and Intakes.

- i.** Remove debris from forebay and gatewell slots.
- ii.** Rake trashracks just prior to the operating season.
- iii.** Measure drawdown in gatewell slots after cleaning trashracks with STSs installed.
- iv.** Inspect and repair gatewell dip net as needed.

2.3.1.2. Submersible Traveling Screens (STS) and Vertical Barrier Screens (VBS).

- i.** Maintenance completed on all screens.
- ii.** Inspect STSs prior to installation and operate one trial run (dogged off on deck) to ensure proper operation.
- iii.** Log results of trial run.
- iv.** Inspect all VBSs with underwater video camera at least once per year. Repair as needed.

2.3.1.3. Collection Channel.

- i.** Water-up valve capable of operating when needed.
- ii.** Orifice lights are operational.
- iii.** Orifices clean and valves operating correctly.
- iv.** Orifice air backflush system works correctly.

2.3.1.4. Transportation Facilities.

- i.** Primary bypass flume switch gate maintained and in good operating condition.
- ii.** Flume interior smooth with no rough edges.
- iii.** Perforated plate edges smooth with no rough edges.
- iv.** Wet separator and fish distribution system should be maintained and ready for operation as designed.

- v. Brushes and screens on crowders in good condition with no holes in screens or rough edges.
- vi. Crowders maintained, tested, and operating correctly.
- vii. All valves, slide gates, and switch gates maintained and in good operating condition.
- viii. Retainer screens in place with no holes in screens or sharp wires protruding.
- ix. Barge and truck loading pipes should be free of debris, cracks, or blockages. Truck and barge loading hose couplings should have no rough edges and barge loading boom should be maintained and tested.
- x. All sampling equipment should be maintained and in good operating condition prior to watering up the facilities.
- xi. Maintain juvenile PIT-tag system as required (see “*Columbia Basin PIT-tag Information System, General Gate Maintenance and Inspection, Walla Walla District*”, February 2003). Coordinate with PSMFC.
- xii. Mini- and midi-tanks maintained and in good operating condition.

2.3.1.5. Dewatering Structure and Flume.

- i. Inclined screen clean and in good condition with no gaps between screen panels, damaged panels, or missing silicone.
- ii. Screen cleaning system (brush and air flush) maintained and operating correctly.
- iii. Overflow weirs should be maintained, tested and operating correctly.
- iv. All valves should be operating correctly.
- v. Flume interior should be smooth with no rough edges.

2.3.1.6. Avian Predation Areas (Forebay and Tailrace). Inspect bird wires, avian deterrent devices, and other deterrent devices and repair or replace as needed. Where possible, install additional bird wires or other deterrent devices to cover areas of known avian predation activity. Prepare avian abatement contract as needed.

2.3.1.7. Maintenance Records. Record all maintenance and inspections.

2.3.1.8. RSW Maintenance. See section 2.3.2.8 below.

2.3.2. Juvenile Fish Passage Season (April 1–December 15).

Operate April 1–September 30 for juvenile fish bypass, collection, and transport, and October 1–December 15 for adult fallbacks. Operate according to criteria below and in the *Corps of Engineers Juvenile Fish Transportation Plan (Appendix B)*. The transportation program may be revised in accordance with ESA Section 10 permit and the NOAA Fisheries Biological Opinion.

2.3.2.1. Forebay Area and Intakes.

- i.** Remove debris from forebay.
- ii.** Inspect gatewell slots daily (preferably early in day shift) for debris, fish buildup, and contaminating substances (particularly oil). Clean gatewells before they become 50% covered with debris. If the volume of debris precludes the ability to keep the gatewell at least 50% clear, they should be cleaned at least once daily. If flows through an orifice or fish conditions give indications that an orifice may be partially obstructed with debris, the orifice will be closed and backflushed to remove the obstruction. If the obstruction cannot be removed, the orifice shall be closed and the alternate orifice for that gatewell slot shall be operated. If both orifices become obstructed or plugged with debris, the turbine unit will not be operated until the gatewell and orifices are cleared of debris.
- iii.** If a visible accumulation of contaminating substances (e.g., oil) is detected in a gatewell and cannot be removed within 24 hours, the gatewell orifices shall be closed immediately and the turbine unit shut down within one hour until the material has been removed and any problems corrected. A preferred method for removing oil from the water surface is to install lipophilic socks, booms, or pads capable of encapsulating the material, and tie off with a rope for later disposal. Action should be taken as soon as possible to remove oil from the gatewell so the orifice can be reopened to allow fish to exit the gatewell. Orifices shall not be closed for longer than 48 hours.
- iv.** Log gatewell drawdown differentials in bulkhead slots at least once a week.
- v.** Remove debris from forebay and trashracks as necessary to maintain less than 1' of additional drawdown in gate slots (relative to drawdown with a clean screen). Additional raking may be required when heavy debris loads are present in the river. Coordinate turbine unit outages with other project work activities, if possible, to minimize turbine unit outages during the spring.
- vi.** Coordinate cleaning efforts with personnel operating juvenile collection facilities.
- vii.** Dip bulkhead gatewell slots to remove fish prior to installing bulkhead for dewatering bulkhead slot.

2.3.2.2. STS, VBS, and Head Gates.

- i. Operate STSs in cycle mode when average fork length of sub-yearling Chinook or sockeye is greater than 120 mm.
- ii. Operate STSs in continuous-run mode when average fork length of sub-yearling Chinook salmon or sockeye is less than 120 mm or if fish condition deteriorates.
- iii. Inspect each installed STS by underwater video camera once per month. Spot check VBSs at the same time.
- iv. Record STS amp readings daily.
- v. If an STS is damaged or fails during the juvenile fish passage season, follow procedures defined in **section 3.2.2**. In no case should a turbine unit be operated with a missing or a known non-operating or damaged STS.
- vi. Up to half of the STSs may be pulled after October 1 for maintenance as long as unscreened turbine units are not operated.
- vii. Make a formal determination at the end of the season as to the adequacy of STS mesh and any replacement needs.
- viii. Inspect at least two VBSs in two different turbine units between spring and summer. Both turbine units should have been operated frequently in the spring. If a debris accumulation is noted, inspect other VBSs and clean debris as necessary.
- ix. Turbine units are to be operated with *raised* head gates when STSs are installed (April 1 through December 15) to improve fish guidance efficiency (FGE), except as provided in **section 4.3**.
- x. If extreme cold weather is forecasted ($< 20^{\circ}\text{F}$ for ≥ 24 hours) between Thanksgiving and December 15, STSs may be removed. The project will first request special permission from CENWW-OD-T. CENWW-OD-T will inform NOAA Fisheries and FPOM of the action. NOAA's National Weather Service forecast for Lower Monumental Dam is available at:
forecast.weather.gov/MapClick.php?lat=46.56353885200048&lon=-118.53924714099969

2.3.2.3. Collection Channel.

- i. Ensure orifices are clean and operable. Operate at least one orifice per gatewell slot (preferably the north orifice). If the project is operating within MOP, additional orifices may be operated to maintain a full collection channel. If orifices must be closed to repair any part of the facility, monitor the gatewells for fish condition and behavior hourly (unit is operating) or at least every two hours

(unit is not operating). See **section 3.2.2.3** to determine if the turbine unit must be shut down and if fish must be dipped from the gatewell(s).

ii. Ensure that orifice lights are functional and operating in open orifices. Orifice lights and area lights may be turned off the evening before the channel is dewatered at the end of the season to encourage fish to exit the channel volitionally (dewatering occurs December 16 or later). Area lights can be turned on briefly for personnel access if necessary.

iii. Replace all burned out orifice lights within 24 hours of notification. Orifice lights shall remain lighted 24 hours/day.

iv. Orifice jets must hit no closer than 3' from the back wall with the collection channel full.

v. Orifice valves must be either fully open or fully closed.

vi. Backflush orifices at least once per day and more frequently if required. During periods of high debris volumes and fish numbers, April 1 through July 31, orifices should be inspected and backflushed once per 8-hour shift or more frequently as determined by the project biologist, to keep orifices clean.

vii. Water-up valve capable of operating when needed.

2.3.2.4. Dewatering Structure.

i. Assure the trash sweep is operating correctly. The frequency of the sweep should be set as necessary to maintain a clean screen, with a minimum operation of at least once per hour. Operate the air flush as specified by the project biologist to maintain a clean screen.

ii. Hand clean trapezoidal section once a day or as often as needed to maintain a clean condition.

iii. Check overflow weirs to make sure they are operating correctly, perform maintenance as required.

iv. There should be no gaps between screen panels or damaged panels in the inclined screen.

v. Lights at the dewatering structure should be turned off at night, unless needed for personnel access, to encourage fish to move downstream volitionally.

2.3.2.5. Transportation Facilities.

i. All screens should be inspected to make sure there are no holes or sharp edges.

- ii. Crowder screen brushes should be maintained in good operating condition, with no holes or sharp edges on crowder screens.
- iii. Inspect raceway and tank retainer screens to make sure they are clean with no holes or protruding wires.
- iv. Operate wet separator and fish distribution system as designed.
- v. Truck and barge loading facilities in good operating condition.
- vi. Inform PSMFC, in advance if possible, of situations that will require the PIT-tag system to become inoperable (e.g. power outages) or that could result in confounding the interpretation of PIT-tag data (e.g. bypassing fish from raceways to the river, operating in primary bypass mode without an operational full-flow detector, emergency dewaterings).

2.3.2.6. Avian Predation Areas (Forebay and Tailrace).

- i. Bird wires and other avian deterrent devices should be monitored to ensure good condition. Any broken wires or devices should be replaced as soon as possible.
- ii. Harassment program in place to deter avian predation in areas actively used by birds and not covered by bird wires or other devices.
- iii. Project biologists shall routinely monitor project areas to determine areas of active avian predation and, if possible, adjust harassment program to cover these areas or install bird wires or other deterrents to discourage avian predation.

2.3.2.7. Removable Spillway Weir² (RSW).

- i. The RSW in spillbay 8 will be in the raised position and operational on the first day of spring spill for juvenile fish passage.
- ii. When the RSW is in operation, spill through Bay 8 is fixed at approximately 6.8 kcfs. The spillgate shall be raised to where it does not touch flow passing down the RSW.
- iii. When the Northwest River Forecast Center forecasts Lower Monumental inflows above 200 kcfs, initiate aggressive forebay debris removal so that RSW operation will not be impeded and coordinate with RCC and CENWW-OD-T.

² Spillway weirs provide surface passage routes via spillbay(s). Temporary, or Top, Spillway Weirs (TSWs) at Little Goose, McNary and John Day dams can be installed, uninstalled and moved between bays using the gantry crane. Removable Spillway Weirs (RSWs) at Lower Granite, Lower Monumental and Ice Harbor dams are “removed” by controlled descent to the bottom of the forebay.

iv. Complete RSW stow (complete rotation to the landing pad) when inflows exceed 260 kcfs, upstream river gauge flows are increasing, and the NWS forecasts Lower Monumental inflow to exceed 300 kcfs.

v. On or after June 21 (start of summer spill), when average daily total project outflow is less than 30 kcfs and forecasted to remain below 30 kcfs for three days or more on a declining hydrograph, the RSW will be closed and spill will be distributed in patterns for spill with no RSW in **Table LMN- 9**. The RSW will be re-opened if average daily total project outflow increases above 30 kcfs and is forecasted to remain above 30 kcfs for three or more days. The NWRFC inflow forecast for Lower Monumental Dam is available at:

www.nwrfc.noaa.gov/river/station/flowplot/flowplot.cgi?LMNW1

vi. When the project is not spilling, the RSW may be operated for short periods of time upon request by the Project Biologist through CENWW if it appears the juvenile fish transportation facility and barge holding capacities will be exceeded, as described in the *Juvenile Fish Transportation Plan (Appendix B)*.

2.3.2.8. RSW Maintenance (September 1 – April 1). Prior to inspections listed below, if a debris raft is present in the forebay and will interfere with defined operations, a debris spill will be coordinated in accordance with **section 5**. Debris in the RSW seals or between the transition plate and ogee will adversely affect RSW operation.

i. Transition Plate inspection will be performed annually to validate that transition from the RSW to the ogee is intact. The primary means of inspection will be done with divers or an ROV:

- If divers are used, Units 5&6 and spillbays 7&8 will be removed from service. Units 5&6 outages will require deviation from FPP priority order (**Table LMN-5**). Coordination of unit outages will follow normal outage notification guidelines. Up to a week before the inspection, bay 8 will need to be opened 1 or 2 stops to facilitate clearing of debris and silt from the transition plates. Spilling through bay 8 will be coordinated with RCC following normal guidelines.

- If an ROV is used, bay 8 will be out of service for the inspection. The morning of the inspection, bay 8 will need to be opened 1 or 2 stops to facilitate clearing of debris and silt from the transition plates. Spilling water through bay 8 will be coordinated with RCC following normal guidelines.

ii. Transition Plate bolts, umbilical and seal will be inspected by divers and will require the RSW to be disengaged from the face of the dam and tipped back to the pierce point. Prior to moving the RSW, bay 8 will need to be opened 1 or 2 stops to remove debris or silt that has accumulated on the transition plates or beak region that would slide off onto the ogee and cause problems when the RSW is stowed. Spill through bay 8 will occur up to a week before the inspection and will be coordinated with RCC through normal guidelines. This inspection will also

require units 5&6 and bays 7&8 out of service. Units 5&6 outages will require a deviation from FPP priority order. Coordination of the unit outages will follow normal outage notification guidelines. Upon completion of the dive, prior to stowing the RSW, bay 8 will need to be opened up to 3 stops to clean any debris from the ogee. The anticipated duration of this inspection is 1 to 3 days. Reports of the inspection will be submitted to the CENWW biological staff.

iii. Loss of Transition Plate(s) or seals will render the RSW out of service until repaired. The level of inspection will initialize with a diver or ROV inspection as defined above for Transition Plate Inspection. The repair and replacement effort will be similar to Transition Plate Bolt, Umbilical and seal inspection above. The timeframe will be longer to repair and or install a new plate(s) or seals. Required outages will be coordinated as listed above for the necessary actions.

2.3.2.9. Inspection and Record Keeping.

- i. Inspect fish facilities at least once every 8 hours. Inspect all facilities according to fish facilities monitoring program.
- ii. Record all maintenance and inspections.

2.4. Operating Criteria - Adult Fish Facilities.

2.4.1. Winter Maintenance Period (January 1 – end of February).

2.4.1.1. Inspect all staff gauges and water level indicators. Repair and/or clean as necessary.

2.4.1.2. Dewater all ladders and inspect all dewatered sections of fish facilities for projections, debris, or plugged orifices which could injure fish or impede fish passage up the ladder. Fish ladder exit trashracks must have smooth surfaces where fish pass, and must have downstream edges that are adequately rounded or padded. Spare trashracks should be on hand for use as necessary. Inspect all diffuser gratings and chambers annually by dewatering or by using divers or video inspection techniques. All diffuser gratings and chambers are to be dewatered and physically inspected at least every 3 years. Repair deficiencies.

2.4.1.3. Inspect for and clean debris from the fish ladder exits. All trashracks and picketed leads must be clean and installed correctly.

2.4.1.4. Calibrate all water level measuring devices, as necessary, for proper facility operations.

2.4.1.5. Inspect all spill gates and ensure that they are operable.

2.4.1.6. Fish pumps maintained and ready for operation.

2.4.1.7. Maintain adult PIT-tag system as required. Coordinate with PSMFC.

2.4.2. Adult Fish Passage Season (March 1 – December 31).

Note: Operating Ice Harbor within MOP (437'–438' msl) for juvenile salmonids may result in some of the Lower Monumental adult fishway entrances bottoming out on their sills prior to reaching criteria depths. Continuous operation within MOP may also result in increased pumping head on the auxiliary water supply pumps, decreasing the amount of water pumped.

2.4.2.1. Fishway Ladders. Water depth over weirs: 1' to 1.3'.

2.4.2.2. Counting Windows. All counting slots at Lower Monumental Dam are fixed at a width of 19". All equipment should be maintained and in good condition. The counting window and backboard should be cleaned as needed to maintain good visibility.

2.4.2.3. Head on all Fishway Entrances. Head range: 1' to 2'.

2.4.2.4. North Shore Entrances (NSE 1&2). Top of gate elevation on sill = 429'.

- i. Operate both gates.
- ii. Weir depth: 8' or greater below tailwater.

2.4.2.5. Floating Orifice Gates. No floating orifice gates will be operated.

2.4.2.6. South Powerhouse Entrances (SPE 1&2). Top of gate elev. on sill = 432'.

- i. Operate both downstream gates.
- ii. Weir depth: 8' or greater below tailwater. At tailwaters below elevation 440', weirs should be on sill.

2.4.2.7. South Shore Entrances (SSE 1&2). Top of gate elev. on sill = 431'.

- i. Operate both downstream gates.
- ii. Weir depth: SSE 1 operate 8' or greater below tailwater. SSE 2 raised 6' above sill. At tailwaters below elevation 439', SSE 1 weir should be on sill.

2.4.2.8. Channel Velocity. 1.5' to 4' per second.

- i. A permanently installed "*RED LION PLC with DETEC sensor*" type 3020-1002, 4-20 milliamp unit was installed (by Leopold Stevens Inc., Gresham, OR) in the collection channel at the unit 1 / unit 2 transition. The unit is located in the channel's length and width to avoid the non-characteristic high readings that would occur on the slope near an entrance or the non-characteristic low reading that would occur in the turbulent zone on the curve from the pump discharge supply conduit. The location of the sending unit typifies the velocity conditions throughout the length of the channel.

- To read the meter, the toggle switch is positioned in the “ON” position. As the unit warms up the velocity reading output shows the numerical readout increasing. When it stabilizes and repeats a number the reading is recorded.
- The velocity reading is a part of the ladder inspections that are done 3 times per week at Lower Monumental; additionally the reading will be added to the state biologists daily inspection form so that daily readings are documented.

2.4.2.9. Head on Trashracks.

- i. Maximum head of 0.5' on ladder exits.
- ii. Maximum head on south shore picketed leads shall be 0.3'. Maximum head on north shore picketed leads shall be 0.4'.
- iii. Trashracks and picketed leads installed correctly.

2.4.2.10. Staff Gauges and Water Level Indicators. All staff gauges should be readable at all water levels encountered during fish passage period. Repair or clean as necessary.

2.4.2.11. Facility Inspections.

- i. Powerhouse operators shall physically inspect facilities once per day shift and check computer monitor information at least once during each back shift.
- ii. Project biologists shall inspect facilities three times per week. Inspect all facilities according to fish facilities monitoring program.
- iii. Picketed leads shall be inspected during all inspections to ensure they are clean and in the correct position (all the way down).
- iv. Project personnel shall check fishway control system twice per month to ensure calibration. This may be done as part of routine fishway inspections.
- v. Inspect fishways daily for foreign substances (particularly oil). If substances are found, corrective actions should be undertaken immediately.
- vi. Record all inspections.

2.4.2.12. Fishway Temperature Monitoring. From June 1 through September 30, water temperature will be monitored at adult fishway entrances and exits.

- i. Temperature monitors shall be placed within 10 meters of all shore-oriented entrances and exits.
- ii. If possible, the entrance monitor shall be within 1 meter above the ladder floor and at least 10 meters downstream of ladder diffusers to allow for sufficient mixing with surface water.

- iii. The exit monitor shall be within 1 meter above the ladder floor and above all diffusers to allow for sufficient mixing with surface water.
- iv. If an existing temperature monitoring location is proposed to be used for either the exit or entrance, it shall be verified that the site accurately reflects water temperature within 10 meters of the entrance or exit.
- v. Project Fisheries will submit temperature data to the Fish Passage Center (FPC) on a weekly basis for posting online at:
www.fpc.org/river/Q_ladderwatertempgraph.php.

2.5. Fish Facility Monitoring and Reporting.

2.5.1. Project biologists shall inspect fish passage facilities at the frequencies listed in the juvenile and adult fish facilities operating criteria sections.

2.5.2. Weekly Reports. Project Biologists shall prepare weekly reports March 1–December 31, summarizing project operations for Friday–Thursday, and email to CENWW-OD-T by noon the following Monday. Reports shall provide an overview of how the project and fish passage facilities operated during the week and evaluate resulting fish passage conditions, including:

- i. Any out-of-criteria situations observed and subsequent corrective actions taken;
- ii. Any equipment malfunctions, breakdowns, or damage along with a summary of resulting repair activities;
- iii. Adult fishway control calibrations;
- iv. STS and VBS inspections;
- v. Any unusual activities at the project that may have affected fish passage.

2.5.3. Annual Reports. Project biologists shall prepare a draft annual report by February 10 and a final report by March 15 summarizing the operation of the project fish passage facilities for the previous year. The annual report shall also include a description of actions taken to discourage avian predation at the project, and an overview of the effectiveness of those activities in discouraging predation.

2.5.4. Project Inspections. Project biologists inspect project facilities once per month and during dewaterings for the presence of zebra and Quagga mussels. Biologists shall provide a report to CENWW-OD-T on a monthly basis summarizing mussel inspections.

3. FISH FACILITIES MAINTENANCE

3.1. Dewatering & Fish Handling.

3.1.1. Project biologists should be present to provide technical guidance at all project activities that may involve fish handling. All dewatering (also referred to as “unwatering”) shall be accomplished in accordance with approved *Dewatering Guidelines and Fish Salvage Plans* (**Appendix F**). When river temperatures reach 70°F or greater, all adult fish handling will be

coordinated through CENWW-OD-T. *Dewatering Plans*³ were reviewed and revised in 2011 to ensure that they comply with **Appendix F**.

3.2. Maintenance - Juvenile Fish Facilities.

3.2.1. Scheduled Maintenance. Scheduled maintenance of juvenile facilities is conducted throughout the year. Long-term maintenance or modifications that require facilities to be out of service for extended periods of time are conducted during the winter maintenance period (December 16–March 31). During the fish passage season parts of the facilities are maintained on a daily, weekly, or longer interval to keep them in proper operating condition.

3.2.2. Unscheduled Maintenance. Unscheduled maintenance is to correct any situation that prevents facilities from operating according to criteria or that will impact fish passage or survival.

3.2.2.1. Notification/Reporting. Maintenance of facilities such as STSs, which sometimes break down during fish passage season, will be carried out as described below. In these cases, repairs will be made as prescribed and CENWW-OD-T will be notified as soon as possible after it becomes apparent that repairs are required. The Operations Manager has the authority to initiate work prior to notifying CENWW-OD-T if a delay of the work will result in an unsafe situation for people, property, or fish. Unscheduled maintenance that will have a significant impact on fish passage shall be coordinated with NOAA Fisheries and FPOM on a case-by-case basis by CENWW-OD-T. Information required by CENWW-OD-T includes:

- i.** Description of the problem;
- ii.** Type of outage required;
- iii.** Impact on facility operation;
- iv.** Length of time for repairs;
- v.** Expected impacts on fish passage and proposed measures to mitigate them.

3.2.2.2. STS. The STSs are inspected periodically throughout the juvenile migration season with a video monitoring system. If a screen is found to be damaged it will be removed and either replaced with the spare STS or repaired and returned to service. A turbine unit shall not be operated with a known damaged or nonfunctioning STS or without a full complement of STSs. If an STS fails on a weekend or at night when maintenance crews are not available, the respective turbine unit will be shut down and generation switched to another, fully screened unit. If all screened turbine units are in service, water may be spilled until the affected STS can be removed and repaired or replaced.

3.2.2.3. Gatewell Orifices. Each gatewell has two 12" orifices with air operated valves to allow fish to exit the gatewell. Under normal operation, one orifice per gatewell is operated. To minimize blockage from debris, orifices are cycled and backflushed at least once per day, and more frequently if required by heavy debris loads. If an air-valve fails, the valve should be closed and the alternate orifice for that gatewell operated until repairs can be made. If both orifices are blocked with debris, damaged, or must be kept closed, the turbine unit will be taken out of service until repairs can be made. If repairs are to take longer than 48 hours,

³ Project Dewatering Plans are available on the FPOM website at: pweb.crohms.org/tmt/documents/FPOM/2010/

juvenile fish will be dipped from the gatewell with a gatewell dip basket. During any closure event of orifices in an operating turbine unit, gatewells will be checked hourly. During times of high fish passage or if there is evidence of any difficulty in holding fish in gatewells, fish are to be dipped from the gatewells at a more frequent interval.

3.2.2.4. Dewatering Structure. The dewatering structure acts as a transition from the collection channel to the corrugated metal flume. An inclined screen allows excess water to be bled off, with all fish and remaining water transitioning into the corrugated metal flume. The excess water is discharged into the adult fish facility auxiliary water supply system and is also used as the water supply for the transportation facilities. The dewatering structure contains a trash sweep and air burst system for cleaning the inclined screen of impinged debris. If the cleaning systems break and interfere with juvenile fish passage through the structure or if the inclined screen is damaged, an emergency bypass system at the upstream end of the dewatering structure will be used to bypass juveniles while repairs are made. Operation of the emergency bypass system requires the juvenile bypass system to be dewatered and stoplogs inserted at the upstream end of the inclined screen. The emergency bypass is then opened and the bypass system operated with 6 gatewell orifices open. Orifices will then need to be routinely rotated, every three hours, in order to let juveniles emigrate from all of the gatewells. While the facilities are in emergency bypass operation, project personnel shall monitor gatewells for signs of fish problems or mortality. Spill may be provided as an alternative avenue for fish passage during a collection channel outage.

3.2.2.5. Bypass Flume. The corrugated metal flume transports juveniles to either the transportation facilities or to the river below the project (primary bypass). If there is a problem with the flume that interferes with its operation, the emergency bypass system at the upper end of the flume can be opened and all of the fish in the bypass system diverted to the river below the project through the secondary emergency bypass system while repairs are made. Since the piping to the river for secondary emergency bypass is also part of the raw water supply for the load and hold facility, the load and hold must be evacuated of fish and dewatered before going into secondary emergency bypass.

3.2.2.6. Transportation Facilities. The transportation facilities can be operated to collect and hold juveniles for the transportation program or to bypass them back to the river (secondary bypass). If part of the facility malfunctions or is damaged, efforts will first be made to bypass the fish around the damaged area. If this is not possible, the fish will be bypassed to the river via the primary bypass pipe.

3.3. Maintenance - Adult Fish Facilities.

3.3.1. Scheduled Maintenance. Scheduled maintenance of a facility that must be dewatered to work on or where maintenance will have a significant effect on fish passage will be done during the January–February winter maintenance period. Maintenance of facilities that will have no effect on fish passage may be conducted at any time. Maintenance is normally conducted on one fish ladder at a time during the winter to provide some fish passage at all times. When facilities are not being maintained during the winter maintenance period, they will be operated according to normal criteria unless otherwise coordinated with NOAA Fisheries and FPOM.

3.3.1.1. Auxiliary Water Supply System. The auxiliary water for the ladders and collection systems is supplied by three turbine-driven pumps on the north shore, with at least two pumps being required for normal operation. On a monthly basis, each pump, one pump at a time, may be taken out of service for up to two days for maintenance. The maintenance performed during this outage is routine monthly and quarterly maintenance as defined within the COE maintenance program. This maintenance will not be performed when river conditions will not allow the ladder to remain in criteria using only a two-pump operation.

3.3.2. Unscheduled Maintenance.

3.3.2.1. Notification/Reporting. Unscheduled maintenance that will significantly affect the operation of a facility will be coordinated with NOAA Fisheries and other FPOM participants. Coordination procedures for unscheduled maintenance of adult facilities are the same as for juvenile facilities in **section 3.2.2.1**. If part of a facility malfunctions or is damaged during the fish passage season and the facility can still be operated within criteria without any detrimental effects on fish passage, repairs may not be conducted until the winter maintenance period or until fewer numbers of fish are passing the project. If part of a facility is damaged or malfunctions that may significantly impact fish passage, it will be repaired as soon as possible.

3.3.2.2. Fish Ladders and Counting Stations. The fish ladders contain fixed weirs, counting stations with picket leads, and fish exits with trashracks. If any part of the ladder fails or is blocked with debris during the fish passage season, efforts will first be made to correct the problem without dewatering. Trashracks, picket leads, and counting stations can sometimes be repaired or maintained without dewatering the ladder. The decision to dewater the ladder and make repairs during the fish passage season or wait until the winter maintenance period will be made after coordination with the fish agencies and tribes.

3.3.2.2.a. Hazardous Materials Spill. In the event of a hazardous materials spill, the Project Biologist has the authority to make fishway adjustments outside of operating criteria as necessary to prevent contamination of the ladder until unified command is formed and consultation is established with FPOM. NOAA Fisheries will be notified within 24 hours of a ladder closure.

3.3.2.3. Auxiliary Water Supply (AWS). The auxiliary water for fish ladders and collection systems is supplied by three turbine-driven pumps on the north shore, with at least two pumps required for normal operation. If one, two, or all three pumps fail, the fishway will be adjusted in the following manner until repairs can be made:

- i.** SPE 2 and/or SSE 2 will be closed and SPE 1 raised to provide the required 1-2' head differential in the system. If the desired differential cannot be reached by the time SPE 1 reaches 5' below tailwater, SPE 1 should be closed, the collection channel bulkheaded off at the junction pool, and NSE 1 and 2 and SSE 1 operated as deep as possible to maintain the head. If it cannot be maintained at a depth greater than 6', the weirs should be maintained at 6' regardless of head differential.

3.3.2.4. Fishway Entrances. The fishway entrances consist of main entrance weirs with hoists and automatic controls. If any of the automatic controls malfunction, the weirs can be operated manually by project personnel and kept within criteria. If there is a further failure which prevents an entrance from being operated manually, the weirs can usually be left in a lowered position while repairs are being conducted or the entrance may be closed and the water redistributed to other entrances while repairs are made.

3.3.2.5. Diffuser Gratings. Diffuser chambers for adding auxiliary water to fish ladders and collection channels are covered by gratings attached by several different methods. Diffuser gratings are normally checked during winter maintenance to ensure they are in place, either by dewatering and physically inspecting the diffuser gratings, or by using underwater video cameras, divers, or other methods. Diffuser gratings may come loose during the fish passage season due to a variety of reasons. Daily inspections of fish ladders and collection systems should include looking for any flow changes that may indicate problems with diffuser gratings. If a diffuser grating is known or suspected to have moved, creating an opening into a diffuser chamber, efforts must immediately be taken to correct the situation and minimize impacts on adult fish in the fishway. Coordination should begin immediately through the established unscheduled maintenance coordination procedures in **section 3.2.2.1**. If possible, a video inspection should be done as soon as possible to determine the extent of the problem. If diffuser gratings are found to be missing or displaced, creating openings into the diffuser chambers, a method of repair shall be developed and coordinated with the fish agencies and tribes through the established coordination procedure. Repairs shall be made as quickly as possible unless coordinated differently.

4. TURBINE UNIT OPERATION & MAINTENANCE

4.1. Turbine Unit Priority Order.

4.1.1. From March 1 through November 30, turbine units will be operated in the order of priority defined in **Table LMN-5** in order to enhance adult and juvenile fish passage. If a turbine unit is out of service for maintenance or repair, the next unit in the priority order shall be operated.

4.1.2. Unit priority order may be coordinated differently to allow for fish research, construction, or project maintenance activities.

4.1.3. Unit 1 provides the best fish passage conditions by eliminating the eddy at the juvenile fish loading dock and providing attraction flow to the North adult fish ladder. Therefore, the default priority order for fish passage is Units 1-6 (in order from north to south). However, due to blade seal failures on Units 2, 3, and 4, the blades were hydraulically locked at a fixed angle, which restricts these units to a narrow operating range (see 1% range tables in **section 4.2**). To avoid excessive wear and tear from repeated starts/stops, Units 2, 3, and 4 are operated last-on/last-off in the priority order for all flow conditions until repairs are completed (*currently scheduled for Unit 4 by the end of FY18*). When Unit 1 is not available, Unit 2 will be the first priority unit for fish passage.

Table LMN-5. Lower Monumental Dam Turbine Unit Priority Order.

Season	Unit Priority Order
March 1 – November 30 Fish Passage Season	<p><u>DEFAULT</u> 1, 2, 3, 4, 5, 6</p> <p><u>MODIFIED ORDER for Fixed-Blade Units*</u> Start-up (U1 available): 1, 5, 6, 2*, 3*, 4* Start-up (U1 not available): 2*, 5, 6, 3*, 4* Shutdown: 6, 5, 3* or 4* any order, then 2*, 1</p>
December 1 – End of February Winter Maintenance Period	Any Order

*As of Feb 2018, Units 2, 3, and 4 have hydraulically locked blades and will be operated in a modified priority order to minimize starts/stops. When Unit 1 is unavailable, Unit 2 will be first priority for fish passage. When the blade seals are replaced (currently scheduled for Unit 4 in 2018), the unit will resume operating in its default order.

4.2. Turbine Unit Operating Range.

4.2.1. In-Season (April 1–October 31). As defined in the *BPA Load Shaping Guidelines (Appendix C)*, all units will be operated within $\pm 1\%$ of peak turbine efficiency (1% range) to maximize survival of juvenile fish that pass through the turbines. Turbine unit flow and power output at the lower and upper limits of the 1% range are defined in **Table LMN-6**.

4.2.1.1. If operation outside the 1% range is necessary, Project personnel shall record the information to provide to BPA on a weekly basis according to the *Guidelines*. Operation outside the 1% range may be necessary to:

- i. Meet BPA load requests made pursuant to BPA's policy, statutory requirements, and *Load Shaping Guidelines (Appendix C)*;
- ii. If the draft tube is to be dewatered (**section 4.3.4**), the unit will be operated at full load $>1\%$ (or at speed-no-load $<1\%$ if not possible to load) for a minimum of 15 minutes prior to installing tail logs in order to flush fish from the unit;
- iii. Operate a turbine unit solely to provide station service; or
- iv. Comply with other coordinated fish measures.

4.2.1.2. Minimum Generation. All of the lower Snake River projects may be required to keep one generating unit online at all times to maintain power system reliability. The minimum generation flow range for each unit is defined in the FOP Table 1 (**Appendix E**), as derived from the lower limits of the 1% range and actual unit operations. During low flow, there may not be enough river flow to meet this generation requirement and the FOP spill target. Under these circumstances, the project will operate the first available priority unit at minimum generation and spill the remainder of outflow. Actual attainable minimum generation may vary depending on real-time conditions.

4.2.2. Off-Season (November 1–March 31). While not required to do so in the off-season, turbines will normally run within the 1% range since it is the optimum point for maximizing energy output of a given unit of water over time. Operation outside the 1% range is allowed if needed for power generation or other needs.

Table LMN-6. Lower Monumental Dam Turbine Unit Power (MW) and Flow (cfs) at ±1% of Peak Turbine Efficiency (Lower and Upper Limits of 1% Range) and Operating Limits. ^a

Project Head (feet)	LMN Units 1 ^b , 2 ^c , 3 ^c - With STS						LMN Units 1 ^b , 2 ^c , 3 ^c - No STS					
	1% Lower Limit		1% Upper Limit		Operating Limit		1% Lower Limit		1% Upper Limit		Operating Limit	
	MW	cfs	MW	cfs	MW	cfs	MW	cfs	MW	cfs	MW	cfs
85	68.6	11,169	128.5	20,905	140.9	24,344	69.2	11,123	125.8	20,216	140.9	23,569
86	69.4	11,154	131.0	21,056	142.8	24,273	70.0	11,109	128.3	20,363	142.8	23,542
87	70.2	11,140	133.5	21,204	144.6	24,200	70.8	11,094	130.8	20,506	144.6	23,513
88	70.9	11,125	136.1	21,348	146.5	24,126	71.6	11,080	133.3	20,645	146.5	23,482
89	71.7	11,111	138.6	21,488	148.3	24,050	72.3	11,066	135.8	20,781	148.3	23,450
90	72.4	11,097	141.2	21,625	150.2	23,974	73.1	11,052	138.3	20,913	150.2	23,415
91	73.3	11,088	141.6	21,418	151.5	23,815	74.0	11,043	138.7	20,714	151.5	23,268
92	74.1	11,079	142.0	21,216	152.8	23,654	74.8	11,035	139.1	20,518	152.8	23,119
93	75.0	11,071	142.4	21,018	154.0	23,492	75.7	11,026	139.5	20,327	154.0	22,968
94	75.8	11,061	142.8	20,824	155.2	23,420	76.5	11,017	139.9	20,140	155.2	22,850
95	76.7	11,052	143.2	20,634	155.2	22,904	77.4	11,009	140.3	19,956	155.2	22,409
96	77.7	11,071	143.3	20,416	155.2	22,592	78.4	11,027	140.4	19,746	155.2	22,125
97	78.8	11,088	143.5	20,203	155.2	22,286	79.5	11,044	140.6	19,540	155.2	21,847
98	79.8	11,105	143.6	19,994	155.2	21,988	80.5	11,061	140.7	19,338	155.2	21,576
99	80.8	11,121	143.8	19,789	155.2	21,696	81.5	11,078	140.9	19,141	155.2	21,309
100	81.8	11,137	144.0	19,589	155.2	21,410	82.6	11,093	141.0	18,947	155.2	21,049
101	82.7	11,138	145.9	19,641	155.2	21,130	83.5	11,095	142.9	18,998	155.2	20,798
102	83.6	11,140	147.8	19,692	155.2	20,857	84.3	11,096	144.8	19,047	155.2	20,553
103	84.5	11,141	149.7	19,741	155.2	20,589	85.2	11,098	146.7	19,095	155.2	20,312
104	85.4	11,142	151.6	19,789	155.2	20,326	86.1	11,099	148.5	19,142	155.2	20,077
105	86.2	11,143	153.5	19,837	155.2	20,069	87.0	11,100	150.4	19,188	155.2	19,846
	LMN Units 4 ^d , 5, 6 - With STS						LMN Units 4 ^d , 5, 6 - No STS					
85	89.8	14,150	123.8	19,493	141.3	25,052	89.5	13,962	122.5	19,102	141.3	24,441
86	91.0	14,160	125.5	19,519	143.3	24,978	90.7	13,971	124.2	19,128	143.3	24,414
87	92.2	14,169	127.2	19,545	145.4	24,904	91.9	13,981	125.9	19,153	145.4	24,385
88	93.4	14,178	128.9	19,569	147.4	24,829	93.1	13,990	127.6	19,177	147.4	24,356
89	94.6	14,187	130.6	19,593	149.4	24,753	94.2	13,998	129.3	19,201	149.4	24,324
90	95.7	14,195	132.3	19,616	151.4	24,676	95.4	14,006	131.0	19,224	151.4	24,291
91	96.9	14,196	133.9	19,613	153.5	24,623	96.5	14,007	132.5	19,221	153.5	24,230
92	98.0	14,197	135.4	19,610	155.2	24,553	97.7	14,008	134.0	19,218	155.2	24,168
93	99.2	14,197	136.9	19,607	155.2	23,936	98.8	14,009	135.5	19,215	155.2	23,577
94	100.3	14,198	138.5	19,603	155.2	23,343	99.9	14,010	137.1	19,211	155.2	23,008
95	101.4	14,198	140.0	19,600	155.2	22,771	101.1	14,010	138.6	19,208	155.2	22,460
96	102.3	14,170	140.5	19,456	155.2	22,389	102.0	13,982	139.1	19,067	155.2	21,828
97	103.2	14,142	141.0	19,315	155.2	22,017	102.9	13,954	139.6	18,929	155.2	21,478
98	104.1	14,114	141.5	19,177	155.2	21,654	103.8	13,928	140.1	18,794	155.2	21,136
99	105.1	14,087	142.0	19,042	155.2	21,300	104.7	13,901	140.5	18,662	155.2	20,803
100	106.0	14,061	142.5	18,909	155.2	20,955	105.6	13,875	141.0	18,532	155.2	20,723
101	107.3	14,091	143.9	18,909	155.2	20,701	106.9	13,904	142.5	18,532	155.2	20,477
102	108.5	14,120	145.4	18,909	155.2	20,452	108.2	13,933	143.9	18,532	155.2	20,236
103	109.8	14,149	146.8	18,909	155.2	20,208	109.4	13,962	145.3	18,532	155.2	19,999
104	111.1	14,177	148.2	18,909	155.2	19,970	110.7	13,989	146.7	18,532	155.2	19,768
105	112.4	14,204	149.6	18,909	155.2	19,736	112.0	14,017	148.1	18,532	155.2	19,541

a. Table values derived from HDC report (July 2003). Flow (cfs) is calculated based on turbine efficiency, head, and power output (MW). "Operating Limit" is the maximum safe operating point, based on cavitation or generator limit (added Feb 2018).

b. Unit 1 was previously fixed-blade and is being restored to adjustable-blade with full 1% range (est. RTS spring 2018).

- c. Units 2 and 3 runner blades are hydraulically locked due to failed blade seals (Sep 2017). Unit 2 is restricted to the lower 1% (~11-13 kcfs) and Unit 3 to the upper 1% (~18-20 kcfs) until the blade seals are replaced.
- d. Unit 4 runner blades are hydraulically locked due to failed blade seals (Dec 2017). Unit 4 is restricted to the upper 1% (~17-19 kcfs) until the blade seals are replaced (currently scheduled in FY2018).

4.3. Turbine Unit Maintenance.

4.3.1. Maintenance Schedule.

4.3.1.1. Turbine unit maintenance schedules will be reviewed annually by Project and Operations Division biologists for fish impacts.

4.3.1.2. Each turbine unit requires annual maintenance that may take from several days to two weeks, and is normally scheduled between mid-July and late November. Maintenance of priority units for adult passage is normally conducted in November–December, but can be conducted in mid-August.

4.3.1.3. Priority unit maintenance will be scheduled for winter maintenance period, or when there are few fish passing the project, to the extent possible. Impacts to migrating adults should be minimized.

4.3.1.4. Turbine units may occasionally require overhauls to repair major problems with the turbine or generator. Overhauls may take over one year to accomplish.

4.3.1.5. Turbine units, governors, exciters, and control systems require periodic maintenance, calibration, and testing which may take them outside of the 1% range. This work will be scheduled in compliance with *BPA Load Shaping Guidelines (Appendix C)* to minimize impacts on juvenile fish.

4.3.2. Operational Testing.

4.3.2.1. Pre-Maintenance: Units may be operationally tested for up to 30 minutes before going into maintenance status by running the unit at speed-no-load and various loads within the 1% range for pre-maintenance measurements and testing, and to allow all fish to move through the unit.

4.3.2.2. Post-Maintenance: Units may be operationally tested after maintenance or repair while remaining in maintenance or forced outage status. Operational testing may consist of running the unit for up to a cumulative time of 30 minutes (within 1% range) before it is returned to operational status.

4.3.2.3. Operational testing of unit under maintenance is in addition to a unit in run status required for power plant reliability. Operational testing may deviate from FPP priority order and may require water that would otherwise be used for spill if the unit running for reliability is at its 1% lower limit (i.e., minimum generation). Water for operational testing will be used from the powerhouse allocation if possible, and water diverted from spill only to the extent necessary to maintain generation system reliability.

4.3.3. Head Gates.⁴

4.3.3.1. Turbine units are to be operated with head gates in the *raised* position to improve fish passage conditions when STSs are installed, except as provided below:

4.3.3.2. Operation of units with head gates in the standard operating position shall be restricted to July 1–December 15, and shall not occur unless at least four other turbine units are available for service. No more than one unit at a time shall be operated with head gates in the standard operating position and the unit will be operated on last-on, first-off priority.

4.3.3.3. Head gates are used to dewater turbine units to facilitate annual maintenance. Unit outage periods will be minimized to the actual time required for maintenance by lowering operating gates in one unit to the standard operating position and connecting to hydraulic cylinders on the afternoon of the last regular workday (typically Thursday) prior to the start of the maintenance. The unit may be operated with head gates in the standard operating position until 0700 hours of the next regular workday (typically Monday).

4.3.3.4. Once maintenance is completed, the turbine unit can be operated with head gates in the standard operating position until 1200 hours of the first regular workday.

4.3.3.5. If unit maintenance or raising of the head gates is delayed beyond the times stated above, the unit shall be immediately taken out of service until work can be completed.

4.3.4. Dewatering Units. Dewatering (also referred to as “unwatering”) should be accomplished in accordance with project *Dewatering Plans*.³ If the turbine unit draft tube is to be dewatered, operate unit with full load for a minimum of 15 minutes prior to installing tail logs. If not possible to load, run unit at speed-no-load for minimum of 15 minutes. This is to reduce the number of fish in the scrollcase prior to installing stop logs. If a turbine unit is out of service for maintenance for an extended period of time without tailrace stoplogs in place, efforts should be made to not open the wicket gates if the scroll case must be dewatered at a later date without the unit being spun beforehand.

4.3.5. Doble Testing. See **Appendix A** for yearly test schedule. Transformer Doble testing is required every three years, or more frequently if there is a known problem with a transformer, and requires the associated turbine units to be out of service for 2–3 workdays. Doble testing is normally scheduled for August or early September in conjunction with other scheduled unit maintenance to minimize impacts on fish passage. To conduct testing, the distribution lines must be disconnected from the transformers and normal generation stopped. One turbine unit will operate at speed-no-load (approximately 5 kcfs) to provide project power and operation of fish passage facilities (station service). Spill may be provided to meet minimum required project discharge during testing. If Doble testing will impact priority units for fish passage, adult passage timing should be considered to minimize impacts to migrating adults. Available units will be operated in accordance with FPP priority order and within the 1% range.

4.3.6. Six-Year Overhaul. One unit per year is scheduled for a 6-year overhaul that requires unwatering the unit to perform more in-depth maintenance other than annual checks. This level

⁴ Head gates may also be referred to as “operating” gates at some projects. The terms are interchangeable.

of maintenance requires additional consideration before the outage (pre-outage) and after the work is complete (post-outage). During the work, many systems and sub-systems of the unit may be disassembled, replaced or repaired. The overhaul unit outage will be scheduled during a period which minimizes impacts to fish. The work will start as recommended in **section 4.3.1**.

4.3.6.1. Pre-Outage: prior to going out-of-service for a 6-year overhaul, the unit may need to be run continuously for 48 hours, which may require a deviation from FPP unit priority in **Table LMN-5**. Scheduling the unit first in line for maintenance should allow for ample water to accomplish a 48-hour run time for pre-maintenance checks. More water will be required for Unit 4, 5 or 6, as these units require an additional 2-3 kcfs at lower operating points.

4.3.6.2. Post-Outage: following a 6-year overhaul, the unit must be run continuously for 48 hours to ensure it is ready for service. A second period of 48 hours of intermittent testing may be required to fix minor items detected in the first continuous run. This post-outage run will require a deviation from FPP unit priority in **Table LMN-5** and from **section 4.3.3** to allow the unit to run with the head gate cylinder in place and the head gate in the lower position. More water will be required for Unit 4, 5 or 6, as these units require an additional 2-3 kcfs at lower operating points. The 1% range constraint will remain in place.

4.3.7. Turbine Unit Outages during High Flows. During high spring flows, turbine unit outages for inspecting fish screens, repairing research equipment (e.g., hydroacoustic or radio-telemetry), and/or other fish items may cause increased spill in order to maintain reservoir levels within operating ranges. This may result in TDG exceeding standards. It is important that this work be conducted when scheduled to ensure that facilities are working correctly and not injuring migrating fish, and that important fish research data are collected. To facilitate this work, reservoir storage may be utilized to minimize impacts from taking turbine units out of service and increasing spill. At Lower Monumental, this special operation shall take place when flow is above 120 kcfs or when increased spill will result in TDG exceeding standards. The activities covered under these operations will be coordinated with TMT whenever possible.

5. FOREBAY DEBRIS REMOVAL

5.1.1. Debris at projects can impact fish passage conditions. Debris can plug or block trashracks, VBSs, gatewell orifices, dewatering screens, separators, and facility piping resulting in impingement, injuries, and descaling of fish. Removing debris at its source in the forebay is sometimes necessary to maintain safe and efficient fish passage conditions, navigation, and other project activities. Debris can be removed from the forebay by: physically encircling the debris with log booms and pulling it to shore with boats where it can be removed with a crane, removing the debris from the top of the dam using a crane and scoop, or passing the debris through the spillway with special powerhouse operations and spill. The preferred option is to remove debris at each project when possible to avoid passing debris on to the next project downstream. This is not always possible at each project as some projects do not have forebay debris removal capability. In this case, the only viable alternative is to spill the debris. Normally, the project shall contact CENWW-OD-T at least two workdays prior to the day the special operation is required. Using information provided by the project, CENWW-OD-T will notify FPOM and RCC will issue a teletype detailing the special operations.

5.1.2. Debris Spill Coordination. All special spills (other than normal patterns for ongoing spill operations) and project operations for passing debris will be coordinated prior to operations taking place. Each project shall contact CENWW-OD-T at least two workdays prior to the day of the requested special project debris spill operation. Project personnel shall provide CENWW-OD-T the reason for the debris spill request including an explanation of project facilities impacted by debris, the date and time of the requested spill, and any special powerhouse or other operations required to move the debris to the spillway. Using information provided by the project, CENWW-OD-T shall coordinate the special operations with RCC, NOAA Fisheries and FPOM. When a debris spill is coordinated and approved, RCC shall issue a teletype detailing the specifics of the special operations.

5.1.3. Emergency Spills. Emergency spills may be implemented if necessary to pass woody debris accumulating in front of the spillbay weir and compromising the safe unobstructed fish passage. The project will immediately spill the woody debris obstructing fish passage and will notify CENWW-OD-T of the emergency spill as soon as possible to notify RCC, NOAA Fisheries, and FPOM.

Table LMN-7. [pg 1 of 3] Lower Monumental Dam Bulk Spill Patterns with RSW. ^a

LMN Bulk Spill Patterns - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
	2				4		RSW	6	16.3
	3				4		RSW	7	17.8
	3			1	4		RSW	8	19.6
	3			1	5		RSW	9	21.3
1	3			1	5		RSW	10	23.1
1	1	1	1	1	6		RSW	11	25.4
1	1	1	1	2	6		RSW	12	26.9
1	1	1	2	2	6		RSW	13	28.4
1	1	1	2	4	5		RSW	14	29.6
1	1	1	2	5	5		RSW	15	31.3
2	1	1	2	5	5		RSW	16	32.8
2	1	2	2	5	5		RSW	17	34.3
2	2	2	2	5	5		RSW	18	35.8
3	2	2	2	5	5		RSW	19	37.3
3	3	2	2	5	5		RSW	20	38.8
3	3	2	2	5	5	1	RSW	21	40.6
3	3	2	2	5	5	2	RSW	22	42.1
3	3	2	3	5	5	2	RSW	23	43.6
3	3	3	3	5	5	2	RSW	24	45.1
3	3	3	3	5	6	2	RSW	25	46.8
3	3	3	3	6	6	2	RSW	26	48.5
3	3	3	3	6	6	3	RSW	27	50.0
3	3	3	3	6	6	4	RSW	28	51.4
3	3	3	3	6	6	5	RSW	29	53.1
3	3	3	3	6	6	6	RSW	30	54.8
3	3	3	4	6	6	6	RSW	31	56.2
3	3	4	4	6	6	6	RSW	32	57.6
3	4	4	4	6	6	6	RSW	33	59.0
4	4	4	4	6	6	6	RSW	34	60.4
4	4	4	5	6	6	6	RSW	35	62.1
4	4	5	5	6	6	6	RSW	36	63.8
4	5	5	5	6	6	6	RSW	37	65.5
5	5	5	5	6	6	6	RSW	38	67.2
5	5	5	6	6	6	6	RSW	39	68.9
5	5	6	6	6	6	6	RSW	40	70.6
5	6	6	6	6	6	6	RSW	41	72.3
6	6	6	6	6	6	6	RSW	42	74.0
6	6	6	6	6	7	6	RSW	43	75.6
6	7	6	6	6	7	6	RSW	44	77.2
6	7	6	6	7	7	6	RSW	45	78.8
6	7	7	6	7	7	6	RSW	46	80.4
6	7	7	7	7	7	6	RSW	47	82.0
7	7	7	7	7	7	6	RSW	48	83.6
7	7	7	7	7	7	7	RSW	49	85.2
7	7	7	7	7	8	7	RSW	50	87.0
7	8	7	7	7	8	7	RSW	51	88.8

LMN Bulk Spill Patterns - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
7	8	7	7	8	8	7	RSW	52	90.6
7	8	8	7	8	8	7	RSW	53	92.4
7	8	8	8	8	8	7	RSW	54	94.2
8	8	8	8	8	8	7	RSW	55	96.0
8	8	8	8	8	8	8	RSW	56	97.8
8	8	8	8	8	9	8	RSW	57	99.4
8	9	8	8	8	9	8	RSW	58	101.0
8	9	8	8	9	9	8	RSW	59	102.6
8	9	9	8	9	9	8	RSW	60	104.2
8	9	9	9	9	9	8	RSW	61	105.8
9	9	9	9	9	9	8	RSW	62	107.4
9	9	9	9	9	9	9	RSW	63	109.0
9	9	9	9	9	10	9	RSW	64	110.8
9	10	9	9	9	10	9	RSW	65	112.6
9	10	9	9	10	10	9	RSW	66	114.4
9	10	10	9	10	10	9	RSW	67	116.2
9	10	10	10	10	10	9	RSW	68	118.0
10	10	10	10	10	10	9	RSW	69	119.8
10	10	10	10	10	10	10	RSW	70	121.6
10	10	10	10	10	11	10	RSW	71	123.3
10	11	10	10	10	11	10	RSW	72	125.0
10	11	10	10	11	11	10	RSW	73	126.7
10	11	11	10	11	11	10	RSW	74	128.4
10	11	11	11	11	11	10	RSW	75	130.1
11	11	11	11	11	11	10	RSW	76	131.8
11	11	11	11	11	11	11	RSW	77	133.5
11	11	11	11	11	12	11	RSW	78	135.2
11	12	11	11	11	12	11	RSW	79	136.9
11	12	11	11	12	12	11	RSW	80	138.6
11	12	12	11	12	12	11	RSW	81	140.3
11	12	12	12	12	12	11	RSW	82	142.0
12	12	12	12	12	12	11	RSW	83	143.7
12	12	12	12	12	12	12	RSW	84	145.4
12	12	12	12	12	13	12	RSW	85	147.1
12	13	12	12	12	13	12	RSW	86	148.8
12	13	12	12	13	13	12	RSW	87	150.5
12	13	13	12	13	13	12	RSW	88	152.2
12	13	13	13	13	13	12	RSW	89	153.9
13	13	13	13	13	13	12	RSW	90	155.6
13	13	13	13	13	13	13	RSW	91	157.3
13	13	13	13	13	14	13	RSW	92	159.0
13	14	13	13	13	14	13	RSW	93	160.7
13	14	13	13	14	14	13	RSW	94	162.4
13	14	14	13	14	14	13	RSW	95	164.1
13	14	14	14	14	14	13	RSW	96	165.8
14	14	14	14	14	14	13	RSW	97	167.5
14	14	14	14	14	14	14	RSW	98	169.2
14	14	14	14	14	15	14	RSW	99	171.0

LMN Bulk Spill Patterns - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
14	15	14	14	14	15	14	RSW	100	172.8
14	15	14	14	15	15	14	RSW	101	174.6
14	15	15	14	15	15	14	RSW	102	176.4
14	15	15	15	15	15	14	RSW	103	178.2
15	15	15	15	15	15	14	RSW	104	180.0
15	15	15	15	15	15	15	RSW	105	181.8

- a. Spill (kcfs) is calculated as a function of total stops + RSW spill at forebay elevation 537.0 ft.
- b. Bay 8 w/ RSW = fixed spill of ~6.8 kcfs at forebay 537.0 ft. Raise Bay 8 tainter gate above stop 9 to ensure free surface and debris passage. When total project outflow is < 30 kcfs, RSW will be closed and spill distributed in patterns defined in **Table LMN- 9** (see criteria in **section 2.3.2.7.v**),

Table LMN-8. [pg 1 of 3] Lower Monumental Dam Uniform Spill Patterns with RSW. ^{a, b}

LMN Uniform Spill Patterns - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
	1	1	1	1	1		RSW	5	15.8
1	1	1	1	1	1		RSW	6	17.6
1	1	1	1	1	1	1	RSW	7	19.4
1	1	1	1	1	2	1	RSW	8	20.9
1	2	1	1	1	2	1	RSW	9	22.4
1	2	1	1	2	2	1	RSW	10	23.9
1	2	2	1	2	2	1	RSW	11	25.4
1	2	2	2	2	2	1	RSW	12	26.9
2	2	2	2	2	2	1	RSW	13	28.4
2	2	2	2	2	2	2	RSW	14	29.9
2	2	2	2	2	3	2	RSW	15	31.4
2	3	2	2	2	3	2	RSW	16	32.9
2	3	2	2	3	3	2	RSW	17	34.4
2	3	3	2	3	3	2	RSW	18	35.9
2	3	3	3	3	3	2	RSW	19	37.4
3	3	3	3	3	3	2	RSW	20	38.9
3	3	3	3	3	3	3	RSW	21	40.4
3	3	3	3	3	4	3	RSW	22	41.8
3	4	3	3	3	4	3	RSW	23	43.2
3	4	3	3	4	4	3	RSW	24	44.6
3	4	4	3	4	4	3	RSW	25	46
3	4	4	4	4	4	3	RSW	26	47.4
4	4	4	4	4	4	3	RSW	27	48.8
4	4	4	4	4	4	4	RSW	28	50.2
4	4	4	4	4	5	4	RSW	29	51.9
4	5	4	4	4	5	4	RSW	30	53.6
4	5	4	4	5	5	4	RSW	31	55.3
4	5	5	4	5	5	4	RSW	32	57
4	5	5	5	5	5	4	RSW	33	58.7
5	5	5	5	5	5	4	RSW	34	60.4
5	5	5	5	5	5	5	RSW	35	62.1
5	5	5	5	5	6	5	RSW	36	63.8
5	6	5	5	5	6	5	RSW	37	65.5
5	6	5	5	6	6	5	RSW	38	67.2
5	6	6	5	6	6	5	RSW	39	68.9
5	6	6	6	6	6	5	RSW	40	70.6
6	6	6	6	6	6	5	RSW	41	72.3
6	6	6	6	6	6	6	RSW	42	74
6	6	6	6	6	7	6	RSW	43	75.6
6	7	6	6	6	7	6	RSW	44	77.2
6	7	6	6	7	7	6	RSW	45	78.8
6	7	7	6	7	7	6	RSW	46	80.4
6	7	7	7	7	7	6	RSW	47	82
7	7	7	7	7	7	6	RSW	48	83.6
7	7	7	7	7	7	7	RSW	49	85.2
7	7	7	7	7	8	7	RSW	50	87
7	8	7	7	7	8	7	RSW	51	88.8

LMN Uniform Spill Patterns - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
7	8	7	7	8	8	7	RSW	52	90.6
7	8	8	7	8	8	7	RSW	53	92.4
7	8	8	8	8	8	7	RSW	54	94.2
8	8	8	8	8	8	7	RSW	55	96
8	8	8	8	8	8	8	RSW	56	97.8
8	8	8	8	8	9	8	RSW	57	99.4
8	9	8	8	8	9	8	RSW	58	101
8	9	8	8	9	9	8	RSW	59	102.6
8	9	9	8	9	9	8	RSW	60	104.2
8	9	9	9	9	9	8	RSW	61	105.8
9	9	9	9	9	9	8	RSW	62	107.4
9	9	9	9	9	9	9	RSW	63	109
9	9	9	9	9	10	9	RSW	64	110.8
9	10	9	9	9	10	9	RSW	65	112.6
9	10	9	9	10	10	9	RSW	66	114.4
9	10	10	9	10	10	9	RSW	67	116.2
9	10	10	10	10	10	9	RSW	68	118
10	10	10	10	10	10	9	RSW	69	119.8
10	10	10	10	10	10	10	RSW	70	121.6
10	10	10	10	10	11	10	RSW	71	123.3
10	11	10	10	10	11	10	RSW	72	125
10	11	10	10	11	11	10	RSW	73	126.7
10	11	11	10	11	11	10	RSW	74	128.4
10	11	11	11	11	11	10	RSW	75	130.1
11	11	11	11	11	11	10	RSW	76	131.8
11	11	11	11	11	11	11	RSW	77	133.5
11	11	11	11	11	12	11	RSW	78	135.2
11	12	11	11	11	12	11	RSW	79	136.9
11	12	11	11	12	12	11	RSW	80	138.6
11	12	12	11	12	12	11	RSW	81	140.3
11	12	12	12	12	12	11	RSW	82	142
12	12	12	12	12	12	11	RSW	83	143.7
12	12	12	12	12	12	12	RSW	84	145.4
12	12	12	12	12	13	12	RSW	85	147.1
12	13	12	12	12	13	12	RSW	86	148.8
12	13	12	12	13	13	12	RSW	87	150.5
12	13	13	12	13	13	12	RSW	88	152.2
12	13	13	13	13	13	12	RSW	89	153.9
13	13	13	13	13	13	12	RSW	90	155.6
13	13	13	13	13	13	13	RSW	91	157.3
13	13	13	13	13	14	13	RSW	92	159
13	14	13	13	13	14	13	RSW	93	160.7
13	14	13	13	14	14	13	RSW	94	162.4
13	14	14	13	14	14	13	RSW	95	164.1
13	14	14	14	14	14	13	RSW	96	165.8
14	14	14	14	14	14	13	RSW	97	167.5
14	14	14	14	14	14	14	RSW	98	169.2
14	14	14	14	14	15	14	RSW	99	171

LMN Uniform Spill Patterns - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
14	15	14	14	14	15	14	RSW	100	172.8
14	15	14	14	15	15	14	RSW	101	174.6
14	15	15	14	15	15	14	RSW	102	176.4
14	15	15	15	15	15	14	RSW	103	178.2
15	15	15	15	15	15	14	RSW	104	180
15	15	15	15	15	15	15	RSW	105	181.8

- a. Spill (kcfs) is calculated as a function of total stops + RSW spill at forebay elevation 537.0 ft (based on interim spillway rating table 2-Apr-2009).
- b. Bay 8 w/ RSW = fixed spill of ~6.8 kcfs at forebay 537.0 ft. Raise Bay 8 tainter gate above stop 9 to ensure free surface and debris passage. When total project outflow is < 30 kcfs, RSW will be closed and spill distributed in patterns defined in **Table LMN- 9** (see criteria in **section 2.3.2.7.v**).

Table LMN- 9. Lower Monumental Dam Spill Patterns with No RSW (Bay 8 Closed). ^{a, b}

LMN Spill Patterns w/ NO RSW - # Gate Stops per Spillbay								Total Stops (#)	Spill ^a (kcfs)
Bay 1	Bay 2	Bay 3	Bay 4	Bay 5	Bay 6	Bay 7	Bay 8 ^b		
	1						CLOSE	1	1.8
	1					1	CLOSE	2	3.6
	1			1		1	CLOSE	3	5.4
	2			1		1	CLOSE	4	6.9
	2			1		2	CLOSE	5	8.4
	2			2		2	CLOSE	6	9.9
	2			2		3	CLOSE	7	11.4
	2			3		3	CLOSE	8	12.9
	2			3		4	CLOSE	9	14.3
	2			3		5	CLOSE	10	16.0
	2			4		5	CLOSE	11	17.4

- a. Spill (kcfs) is calculated as a function of total stops at forebay elevation 537.0 ft.
- b. When total project outflow is < 30 kcfs, RSW will be closed and spill distributed in patterns defined in this table (see criteria in **section 2.3.2.7.v**).